


JH-82207-0419-V7

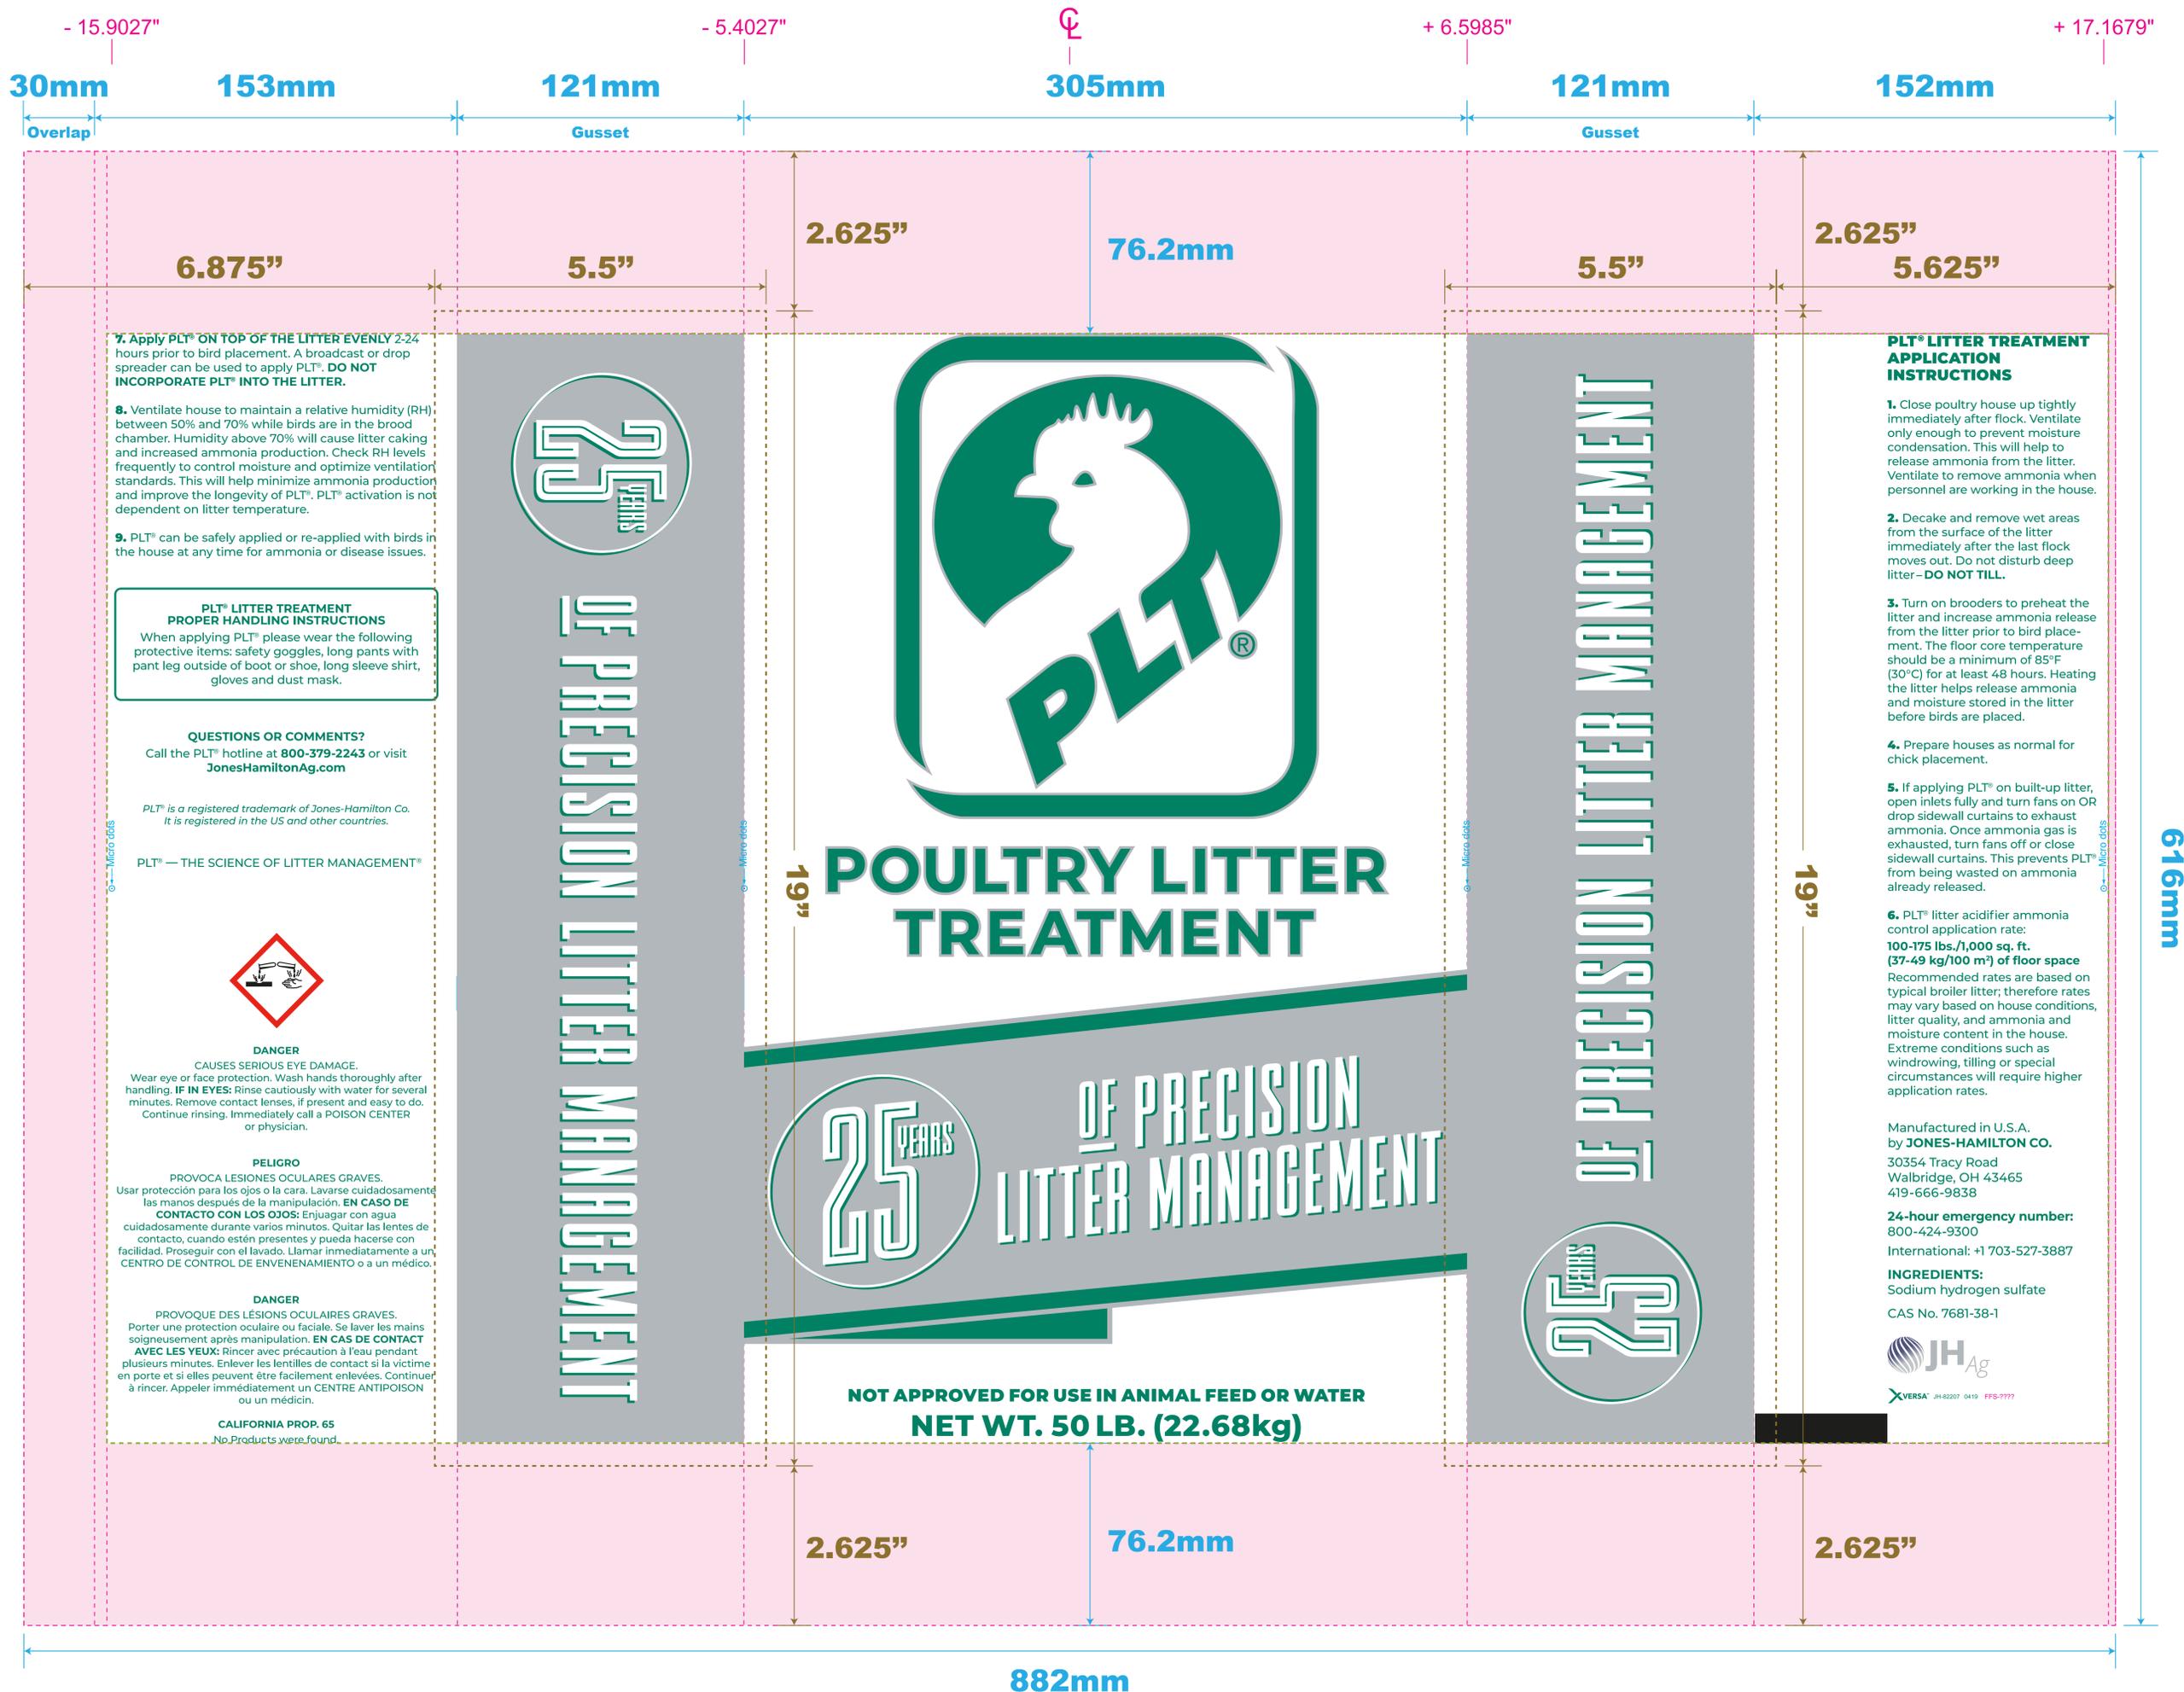

7. Apply PLT® ON TOP OF THE LITTER EVENLY 2-24 hours prior to bird placement. A broadcast or drop spreader can be used to apply PLT®. **DO NOT INCORPORATE PLT® INTO THE LITTER.**

8. Ventilate house to maintain a relative humidity (RH) between 50% and 70% while birds are in the brood chamber. Humidity above 70% will cause litter caking and increased ammonia production. Check RH levels frequently to control moisture and optimize ventilation standards. This will help minimize ammonia production and improve the longevity of PLT®. PLT® activation is not dependent on litter temperature.

9. PLT® can be safely applied or re-applied with birds in the house at any time for ammonia or disease issues.

PLT® LITTER TREATMENT PROPER HANDLING INSTRUCTIONS
When applying PLT® please wear the following protective items: safety goggles, long pants with pant leg outside of boot or shoe, long sleeve shirt, gloves and dust mask.

QUESTIONS OR COMMENTS?
Call the PLT® hotline at 800-379-2243 or visit JonesHamiltonAg.com

PLT® is a registered trademark of Jones-Hamilton Co. It is registered in the US and other countries.

PLT® — THE SCIENCE OF LITTER MANAGEMENT®



DANGER
CAUSES SERIOUS EYE DAMAGE.
Wear eye or face protection. Wash hands thoroughly after handling. **IF IN EYES:** Rinse cautiously with water for several minutes. Remove contact lenses, if present and easy to do. Continue rinsing. Immediately call a POISON CENTER or physician.

PELIGRO
PROVOCA LESIONES OCULARES GRAVES.
Usar protección para los ojos o la cara. Lavarse cuidadosamente las manos después de la manipulación. **EN CASO DE CONTACTO CON LOS OJOS:** Enjuagar con agua cuidadosamente durante varios minutos. Quitar las lentes de contacto, cuando estén presentes y pueda hacerse con facilidad. Proseguir con el lavado. Llamar inmediatamente a un CENTRO DE CONTROL DE ENVENENAMIENTO o a un médico.

DANGER
PROVOQUE DES LÉSIONS OCULAIRES GRAVES.
Porter une protection oculaire ou faciale. Se laver les mains soigneusement après manipulation. **EN CAS DE CONTACT AVEC LES YEUX:** Rincer avec précaution à l'eau pendant plusieurs minutes. Enlever les lentilles de contact si la victime en porte et si elles peuvent être facilement enlevées. Continuer à rincer. Appeler immédiatement un CENTRE ANTIPOISON ou un médecin.

CALIFORNIA PROP. 65
No Products were found.



OF PRECISION LITTER MANAGEMENT



POULTRY LITTER TREATMENT



OF PRECISION LITTER MANAGEMENT

NOT APPROVED FOR USE IN ANIMAL FEED OR WATER
NET WT. 50 LB. (22.68kg)



OF PRECISION LITTER MANAGEMENT

PLT® LITTER TREATMENT APPLICATION INSTRUCTIONS

1. Close poultry house up tightly immediately after flock. Ventilate only enough to prevent moisture condensation. This will help to release ammonia from the litter. Ventilate to remove ammonia when personnel are working in the house.

2. Decake and remove wet areas from the surface of the litter immediately after the last flock moves out. Do not disturb deep litter — **DO NOT TILL.**

3. Turn on brooders to preheat the litter and increase ammonia release from the litter prior to bird placement. The floor core temperature should be a minimum of 85°F (30°C) for at least 48 hours. Heating the litter helps release ammonia and moisture stored in the litter before birds are placed.

4. Prepare houses as normal for chick placement.

5. If applying PLT® on built-up litter, open inlets fully and turn fans on OR drop sidewall curtains to exhaust ammonia. Once ammonia gas is exhausted, turn fans off or close sidewall curtains. This prevents PLT® from being wasted on ammonia already released.

6. PLT® litter acidifier ammonia control application rate:
100-175 lbs./1,000 sq. ft. (37-49 kg/100 m²) of floor space
Recommended rates are based on typical broiler litter; therefore rates may vary based on house conditions, litter quality, and ammonia and moisture content in the house. Extreme conditions such as windrowing, tilling or special circumstances will require higher application rates.

Manufactured in U.S.A. by **JONES-HAMILTON CO.**
30354 Tracy Road
Walbridge, OH 43465
419-666-9838

24-hour emergency number:
800-424-9300
International: +1 703-527-3887

INGREDIENTS:
Sodium hydrogen sulfate
CAS No. 7681-38-1



	No. JOB	CLIENT / CUSTOMER	DESCRIPTION				
		Jones-Hamilton	JH-82207-0419-V7				
	TAILLE / SIZE	IMPRESSION / PRINT	CYLINDRE REPEAT	ACROSS REPEAT			
882mm x 616mm	<input checked="" type="checkbox"/> Surface <input type="checkbox"/> Reverse	24"	1 Up				
Nos artistes ont fait de leur mieux pour vous fournir un travail parfait... cependant, vous êtes responsable de l'approbation finale. Our artists have done everything possible to make it perfect... however, you are responsible for the final approval.							
COULEURS / COLOUR							
Black	Blue 2738	Green 341	Red 485	Grey 429	Lacquer	Treat On Press	No Print Area
Signature / Date							